



# Toxicity of PVC Cable Compounds During Combustion Compared to Halogen-Free Alternatives

Francesca Delchiaro <sup>a</sup>, Gianluca Sarti <sup>a</sup>, Marco Piana <sup>b</sup>, Pasquale Lombardo <sup>c</sup>, Ivano Vassura <sup>c</sup>, Laura Mazzocchetti <sup>c</sup>


a: Reagens S.p.A.; b PVC Forum Italia; Università di Bologna

4<sup>TH</sup> PVC4CABLES CONFERENCE

16 OCTOBER IN PRAGUE

# Index

1. Introduction
2. Decomposition / Combustion of PV
3. Misconceptions about PVC combus
4. New Low Smoke acidity cables
5. Conclusions
6. References
7. About us

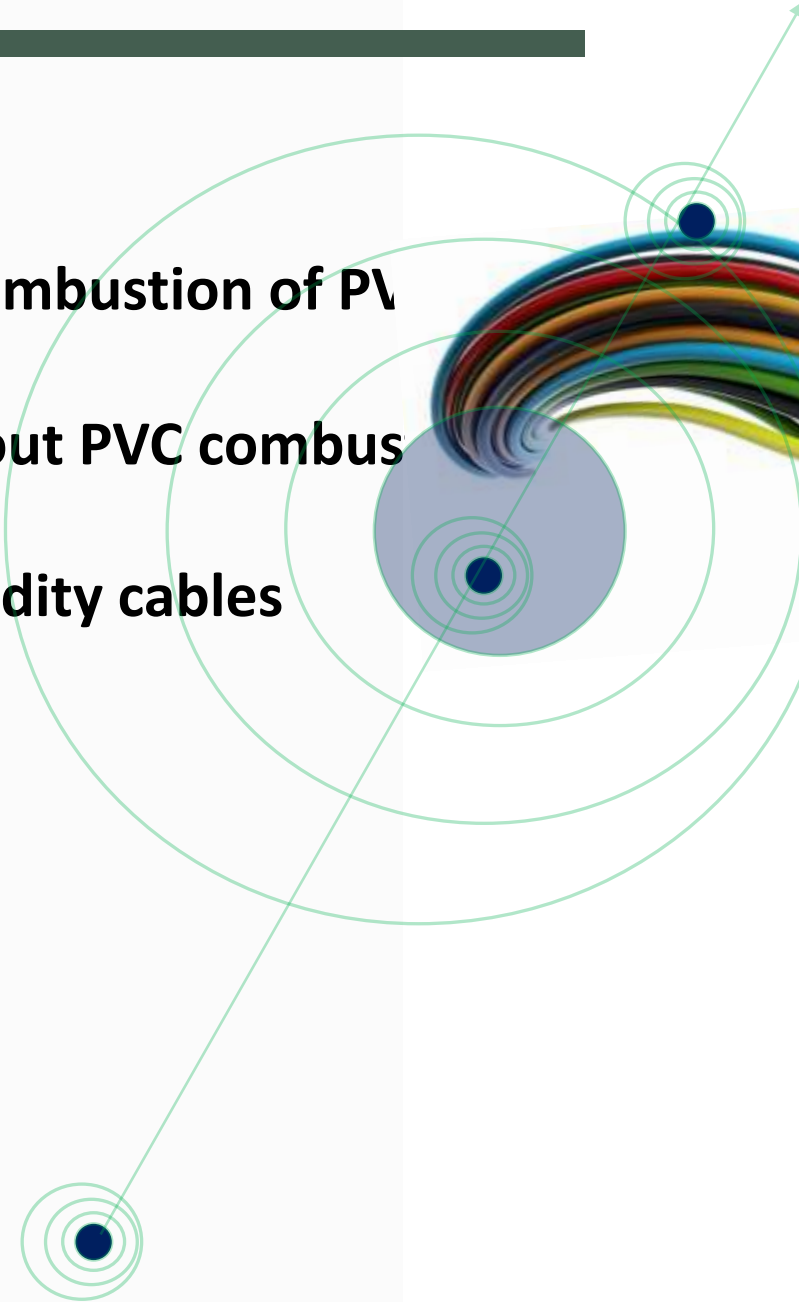

The paper addresses **common misconceptions** about PVC cables, particularly those surrounding **the role of HCl in fire safety** and the presence of more **toxic fumes** during the combustion in comparison to Halogen Free Flame-Retardant (HFFR) cables. Those misconceptions are often utilized in the brochures of our competitor plastics to remark the lower toxicity of HFFR alternatives and inside technical committees to give a priori exclusion of PVC in specific application often without any scientific basis. [1,2,3]

Construction Product Directive (CPD) [4] and Construction Product Regulation (**CPR**) [5] contributed to this witch hunt with the **introduction** of additional **classification for acidity only for cables**, where acidity assessment is seen as fundamental parameter in fire safety. Most of the fire scientists consider acidity as a secondary parameter, while **heat release rate** is the “**single most important variable in fire safety.**” [6,7] Smoke is another critical parameter, while toxicity before and after flashover is ruled by mainly by CO. [8-12]. In a real fire scenario CO is the big toxic killer in smoke [7] while HCl rarely exceed its  $LC_{50}$ . After flashover it is released from every polymer despite its chemical structure for a 20 % of its weight. [7] Before the flashover tenability is mainly driven by CO. [11,12] Therefore, “...there is no relationship whatsoever between acid gases (or acidity of solutions) and smoke toxicity.” [7]

Despite all considerations about the role of acidity in fire safety, the paper presents the performance of advanced PVC compounds for cables developed to reduce smoke and acidic fumes during fires without affecting flame retardance. They are developed by Gruppo Cavi Italia through a research funded by PVC4cables [13-26]. They are called **low smoke acidity (LSA) compounds**.


This new compounds were evaluated vs. the HFFR counterparts in terms of effluent emission in thermal decomposition and combustion using as hyphenated technique pyrolysis gas chromatography mass spectrometry (**PY-GC/MS**) and **toxicity index** according to CEI 20-37/4-0 [27]. Both are based on a bench scale test which burns completely the test specimens and does not take in account the quantity of the material in the cable.

Furthermore, an Italian kind of CPR cables FG16OR16 manufactured with LSA PVC compounds was tested vs. the counterpart HFFR FG16OM16, performing the medium scale fire test EN 50399 [28] in terms of flame spread (FS), Fire growth rate (FIGRA), total heat release (THR), peak of HRR and SPR, and total smoke production (TSP).

CO, CO<sub>2</sub> and HCl release were also measured, and the toxicity of effluents expressed as fractional effective dose (FED) according to ISO 13344 was calculated. [29]

Ref. 30 from Pasquale Lombardo studied the decomposition / combustion at 500 °C and 950°C of a standard R16 PVC compound, R16 LSA and the HFFR counterpart (M16), utilizing PY-GC/MS

### Decomposition & combustion PVC [17]

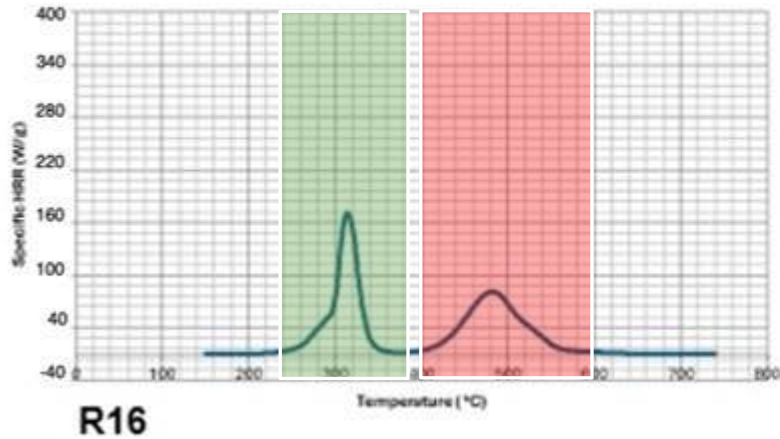


#### ASTM D 7903 method A [31]

**First stage (220-350°C)**, HCl is released via zip-elimination, forming polyene sequences that can rearrange to release aromatic compounds (i.e. heat release and smoke), and crosslinked matrix. HCl reduces and plasticizer increases the flame.

**Second stage (400-600°C)**, the crosslinked structure releases aliphatic hydrocarbons, which burn with high heat but less smoke. The process concludes with char formation, limiting further heat release and flaming dripping.


Additives can shape the sHRR (T)

### Decomposition & combustion HFFR

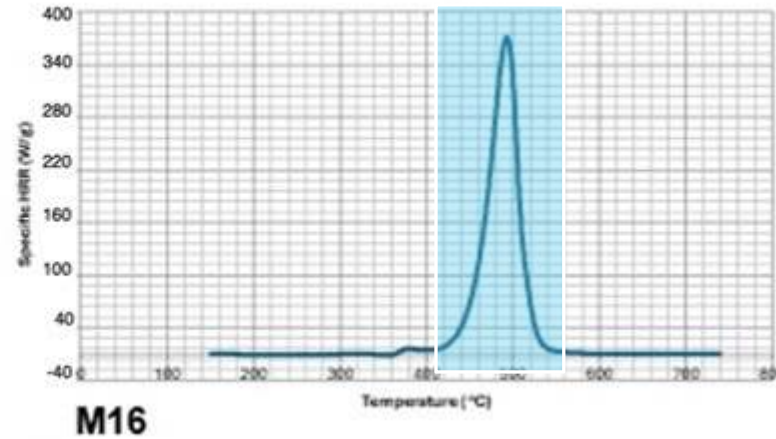

#### 400-500°C: Volatilization of Hydrocarbons

The breakdown of the polymer leads to the volatilization of hydrocarbons, releasing gases such as aliphatic and aromatic hydrocarbons, which sustain the flame. As soon as the temperature increase the formation of aromatics is the preferable route [32]

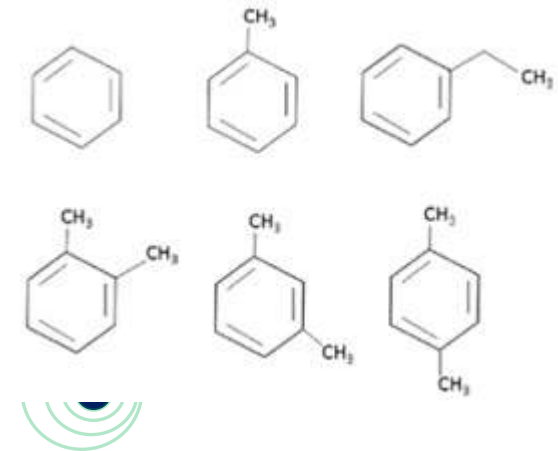

Withstanding **misconceptions** on PVC fire behaviour

If not → PVC deselection

Smoke production



PVC releases black & dense smokes

Smoke toxicity




PVC releases more toxic smokes

acidity





Acidity is a critical parameter in fire safety



TOPIC

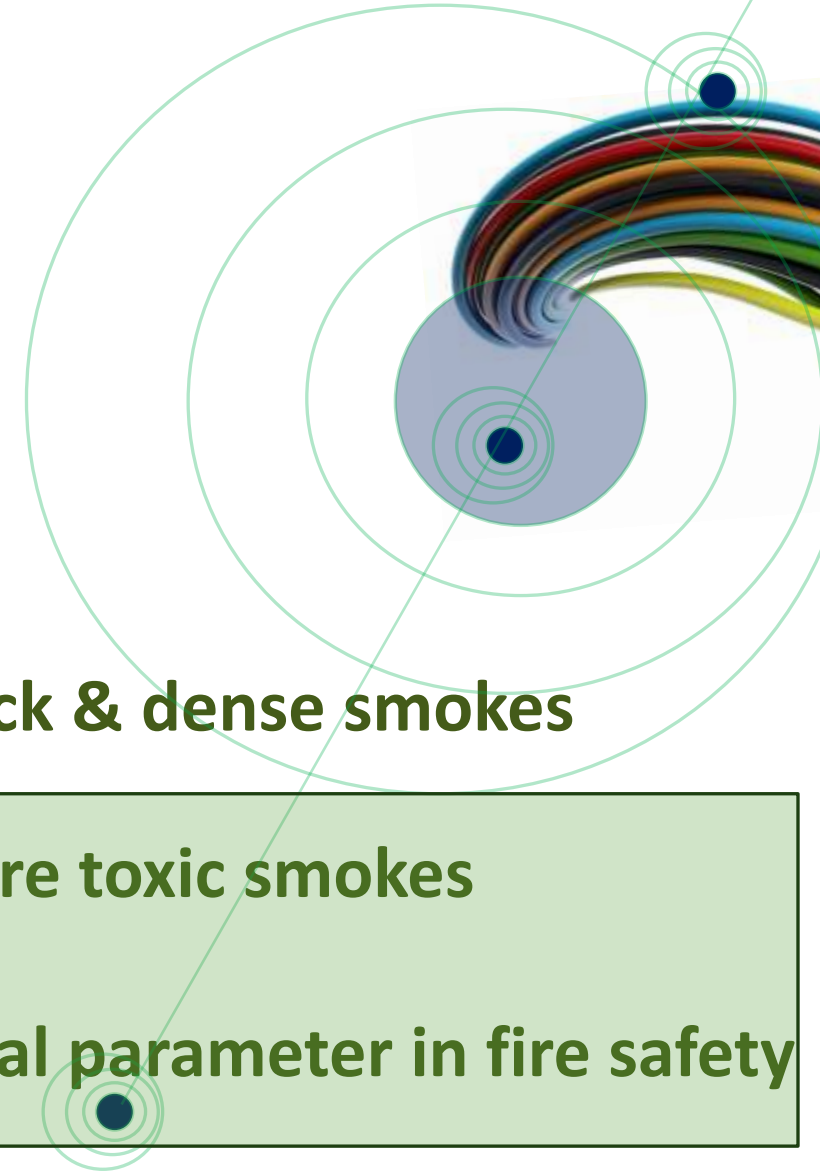

Fire Scenario number 1: 3 minutes between ignition and flashover (the point of non-return)

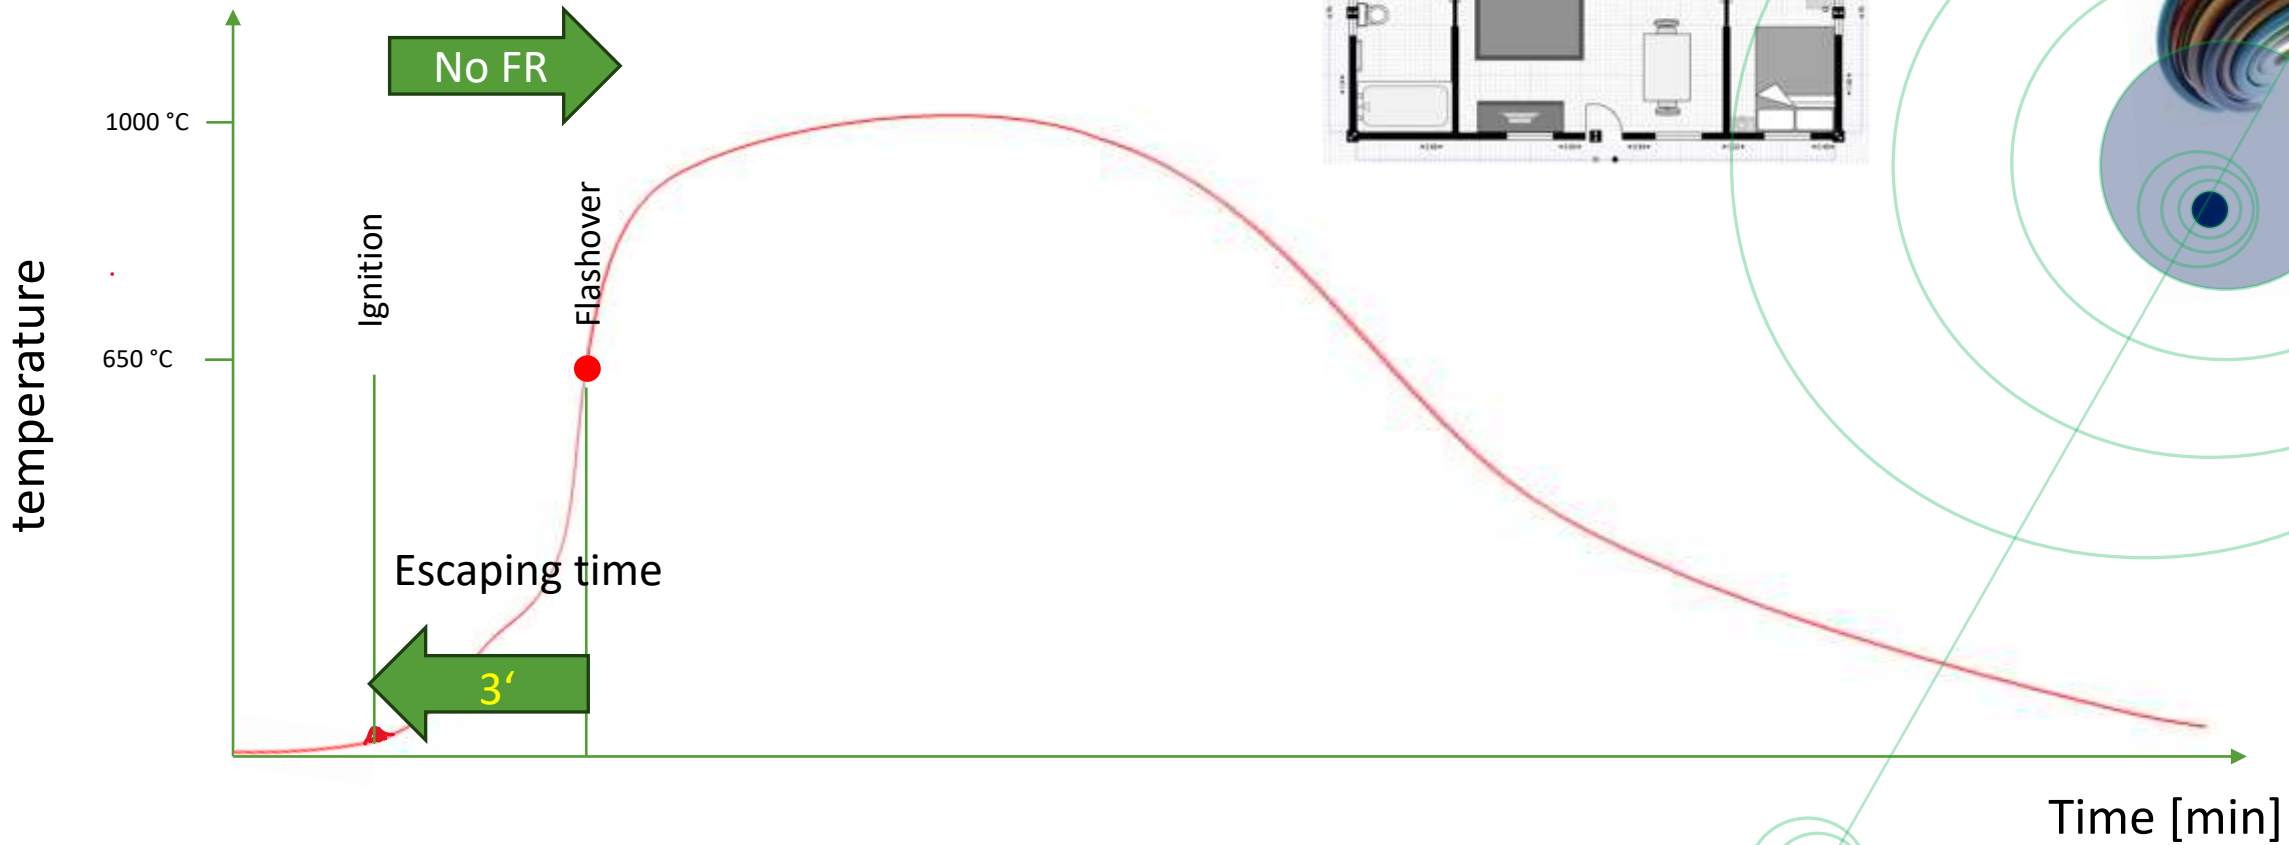


Fire Scenario number 2: 10 minutes between ignition and flashover (the point of non-return)


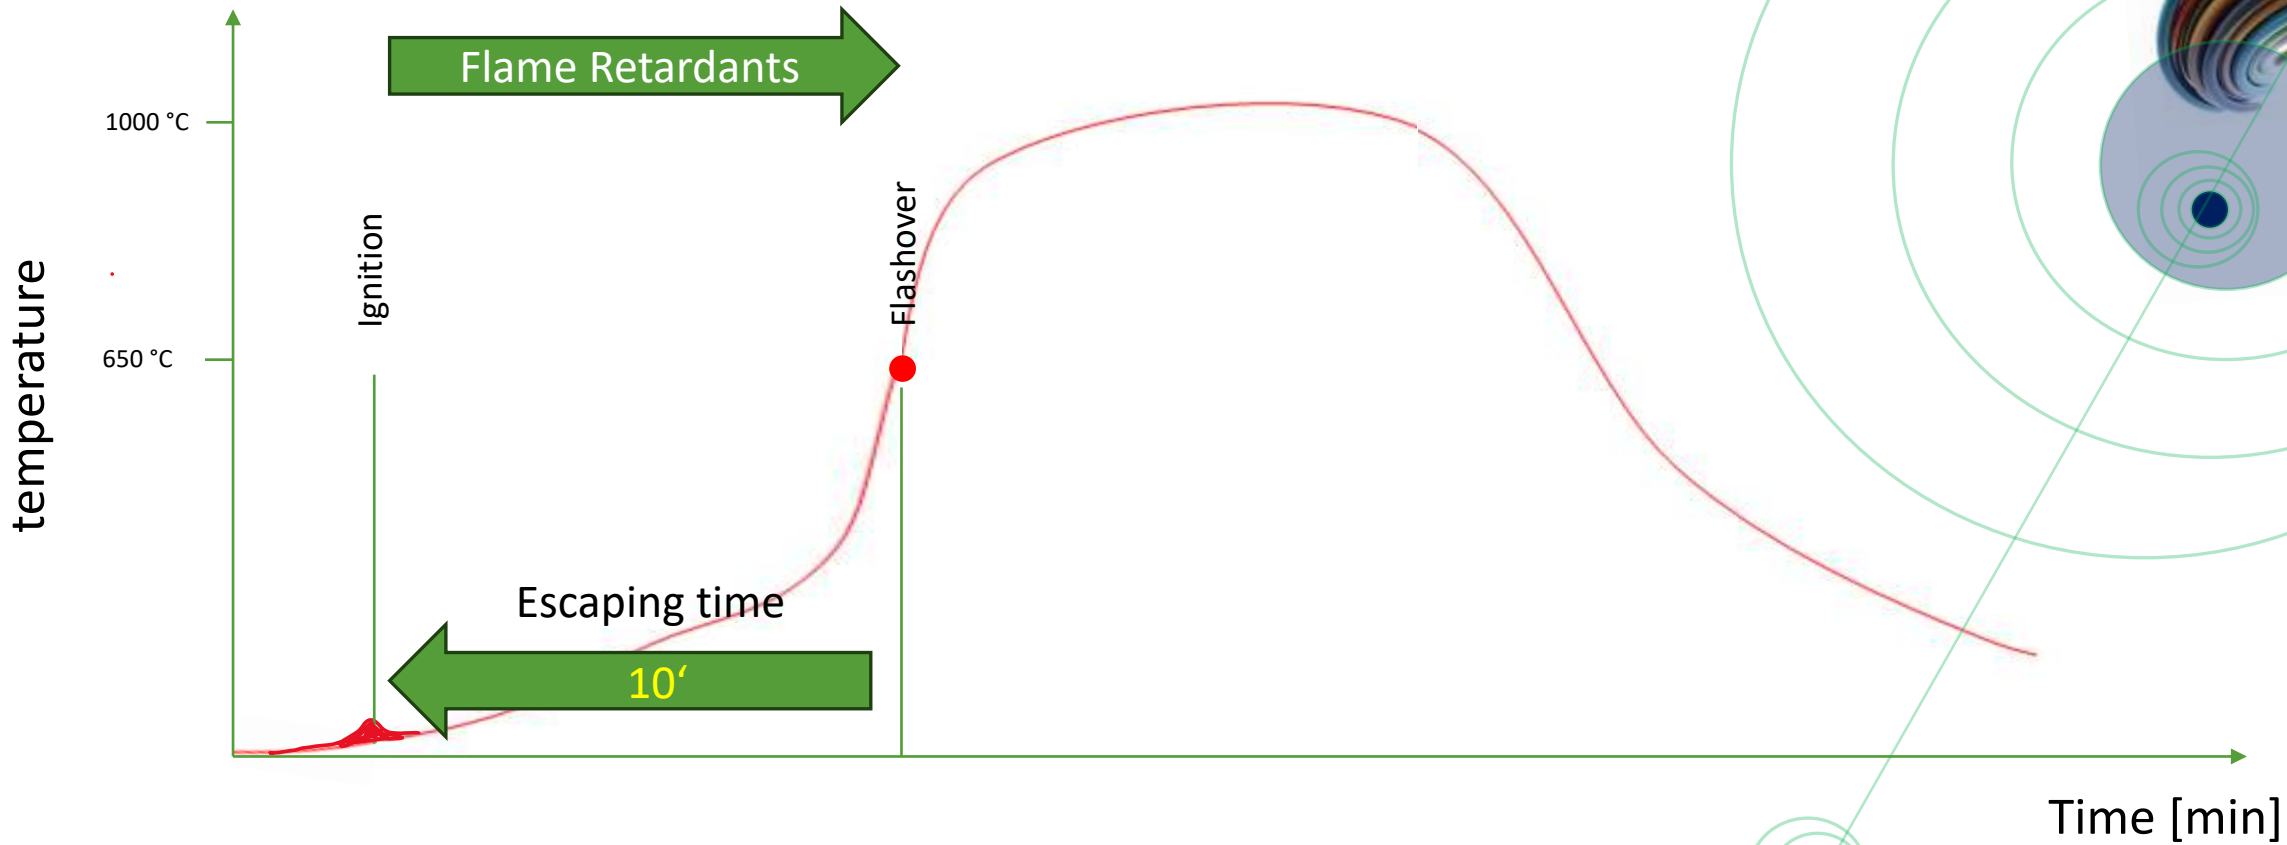


Fire Scenario number 3: **15** minutes between ignition and flashover (the point of non-return)



heat release rate is the “single most important variable in fire safety” [6]

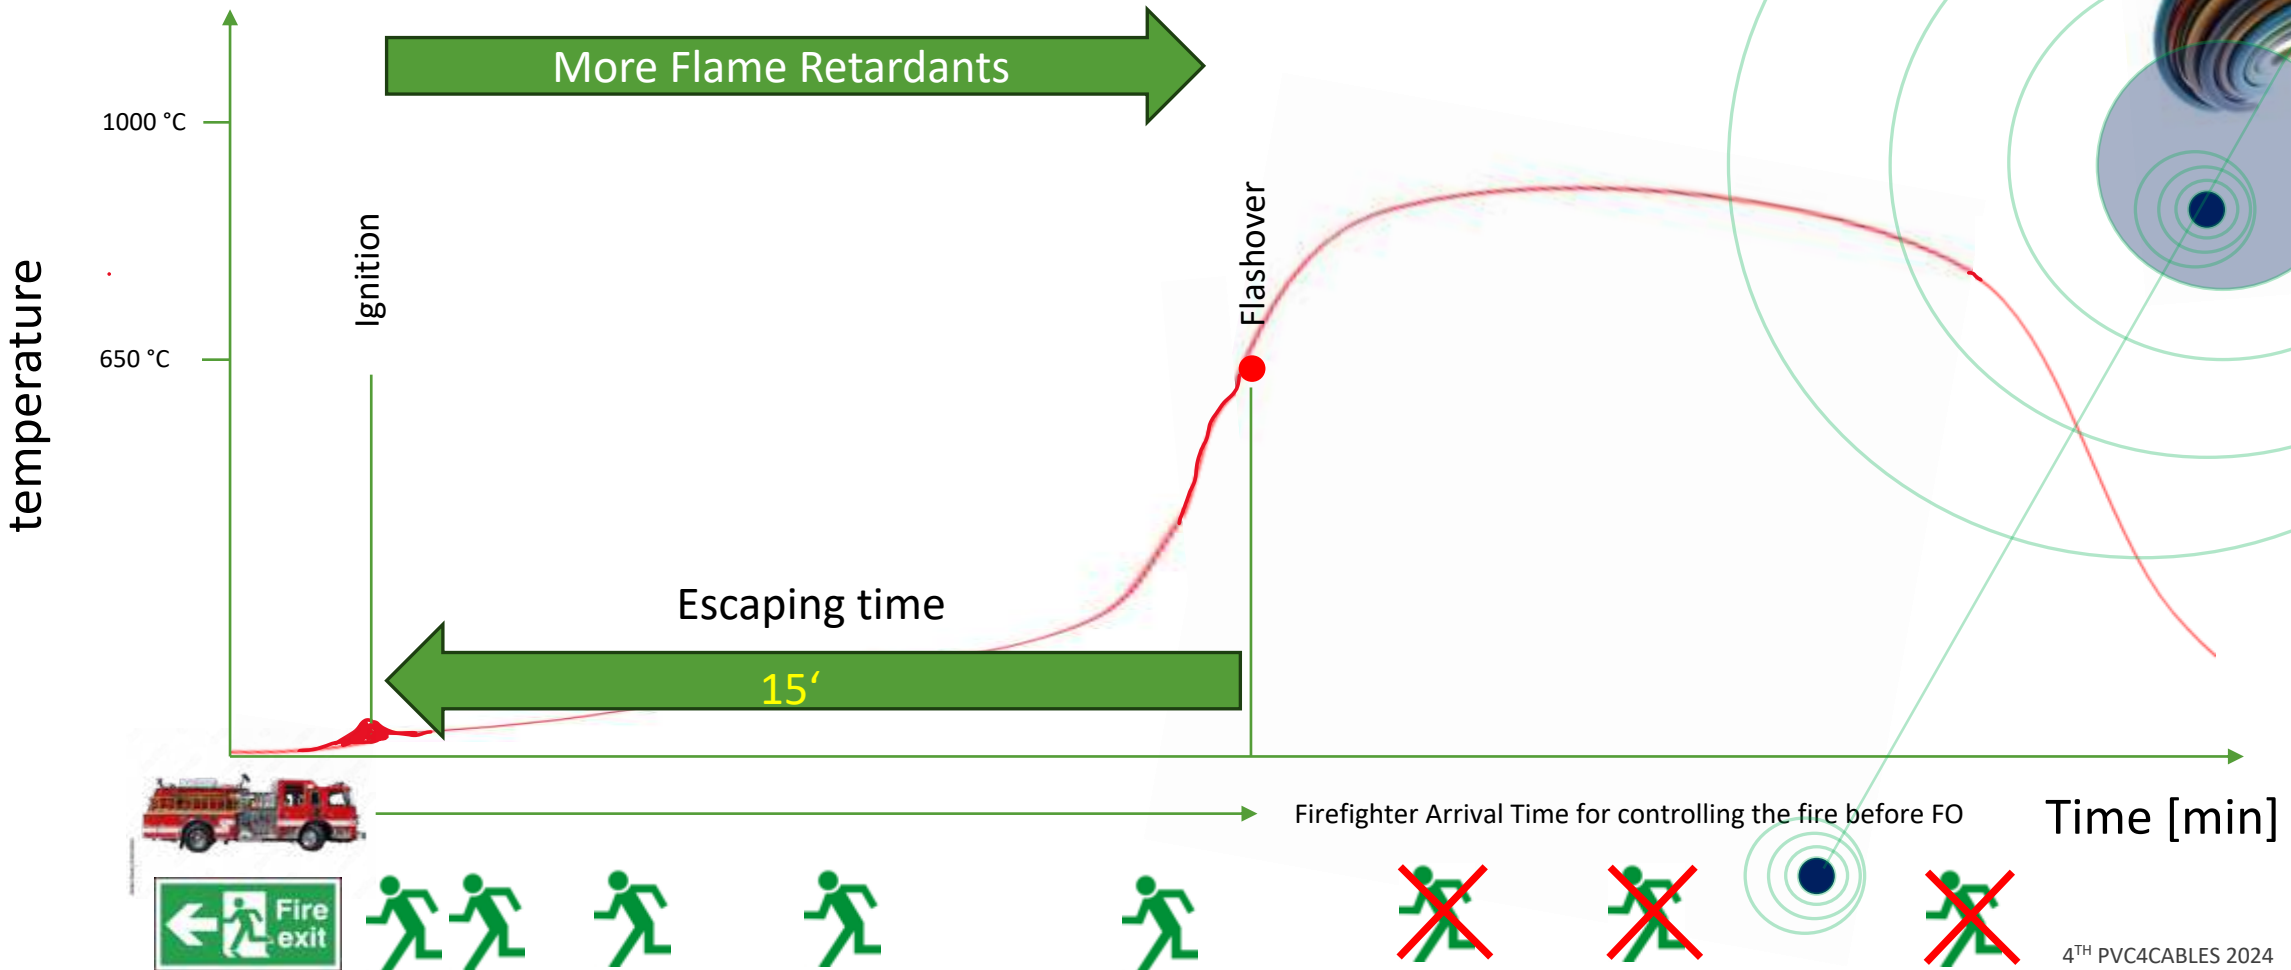


Fire Scenario number 4: 15 minutes between ignition and flashover (the point of non-return), dense smoke

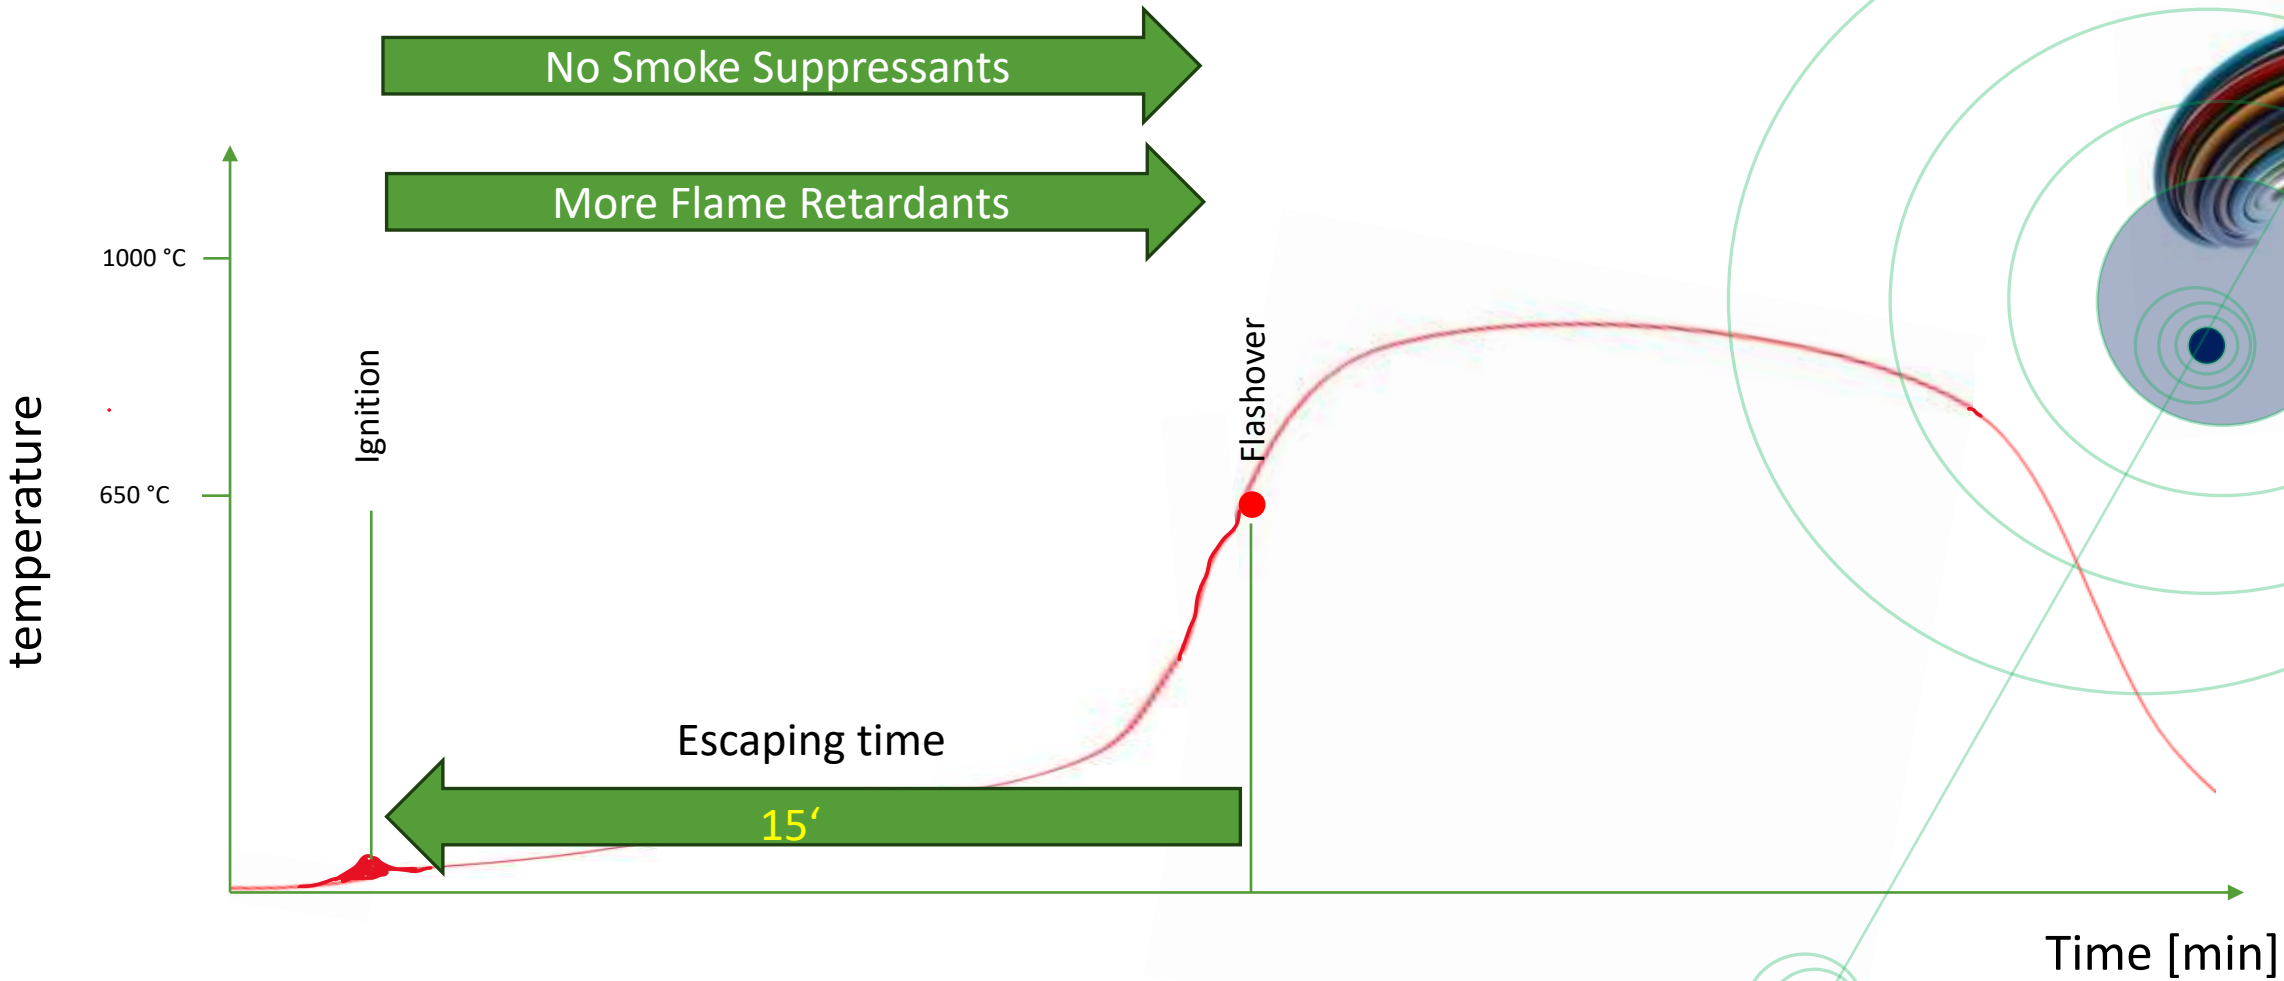

Fire Scenario number 5: 15 minutes between ignition and flashover (the point of non-return), no dense smoke

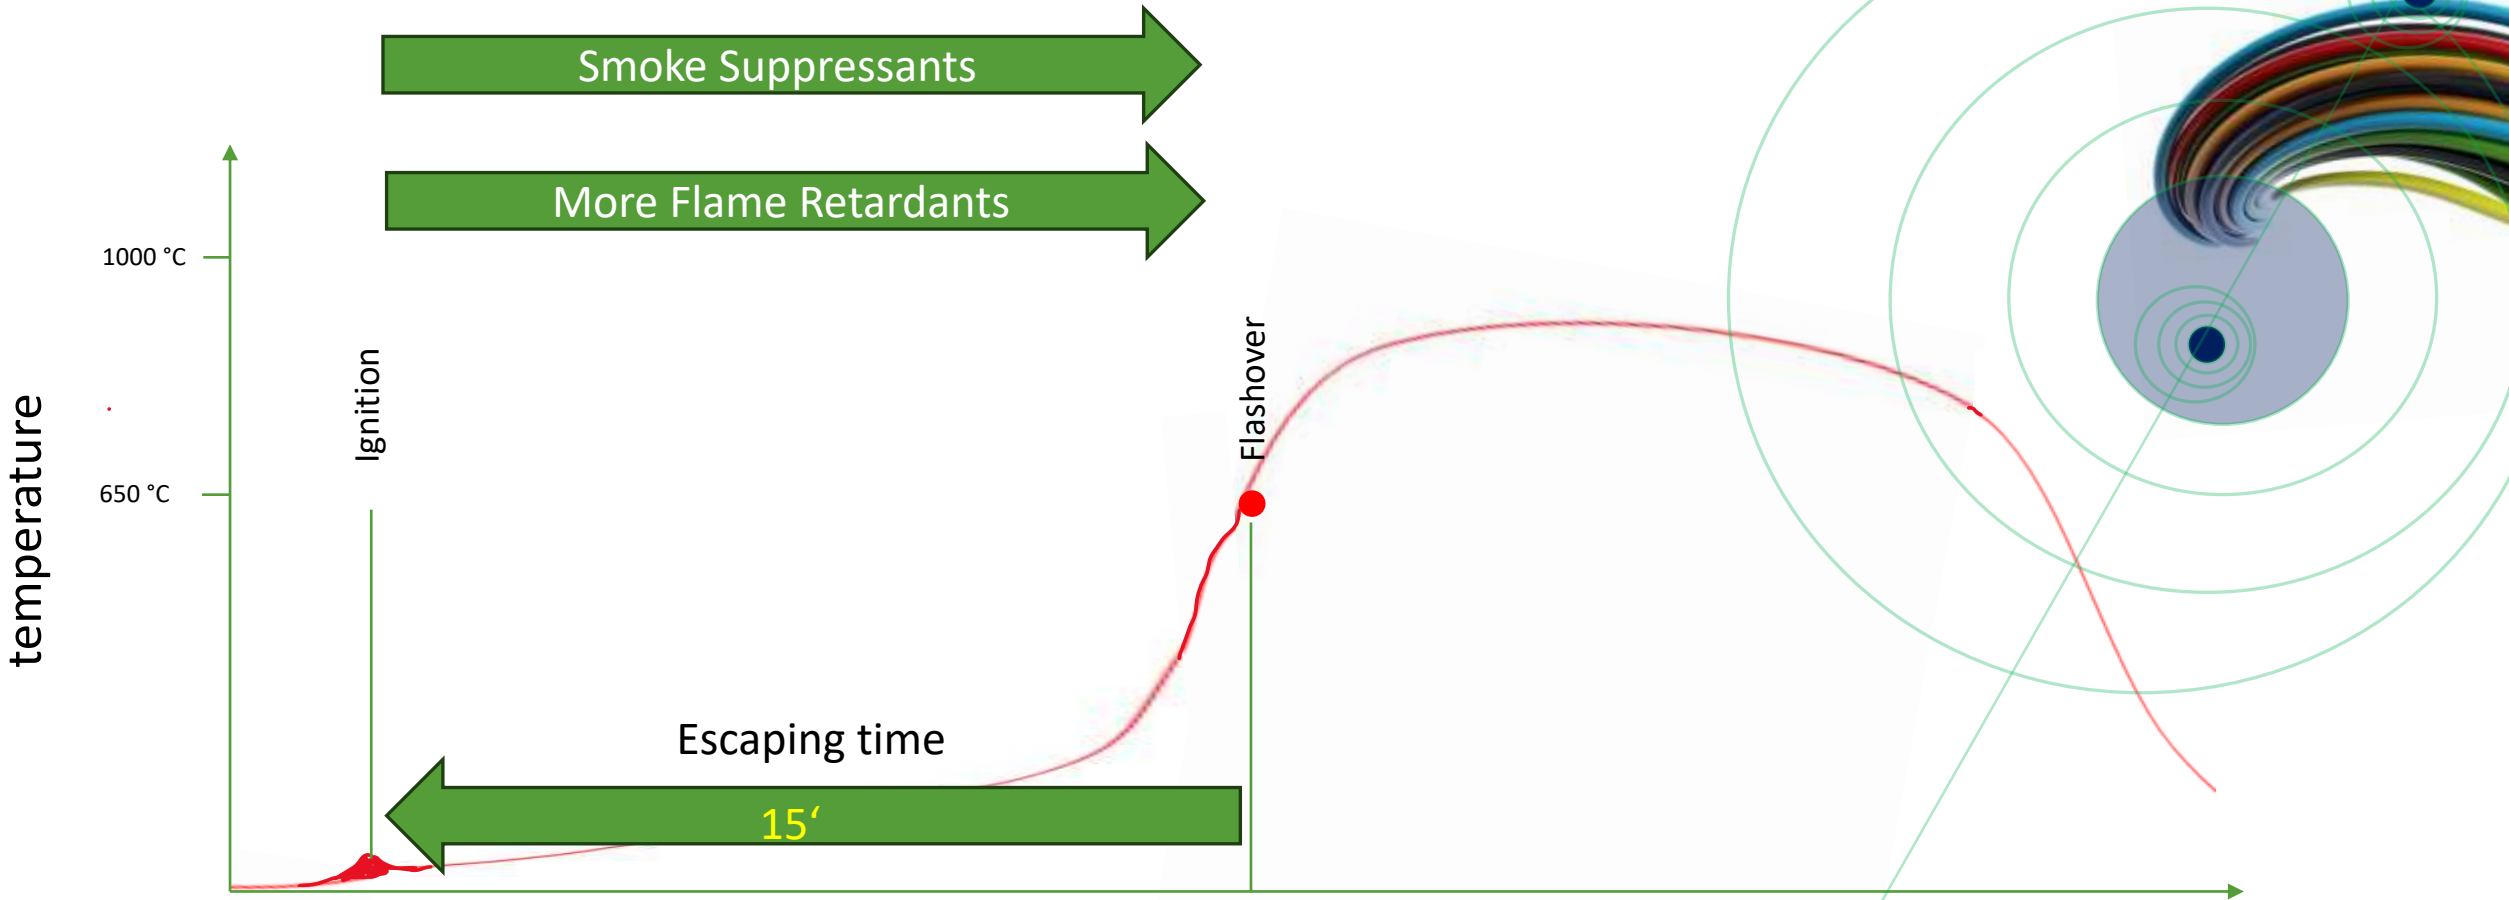


Fire Scenario number 5: 15 minutes between ignition and flashover (the point of non-return), no dense smoke

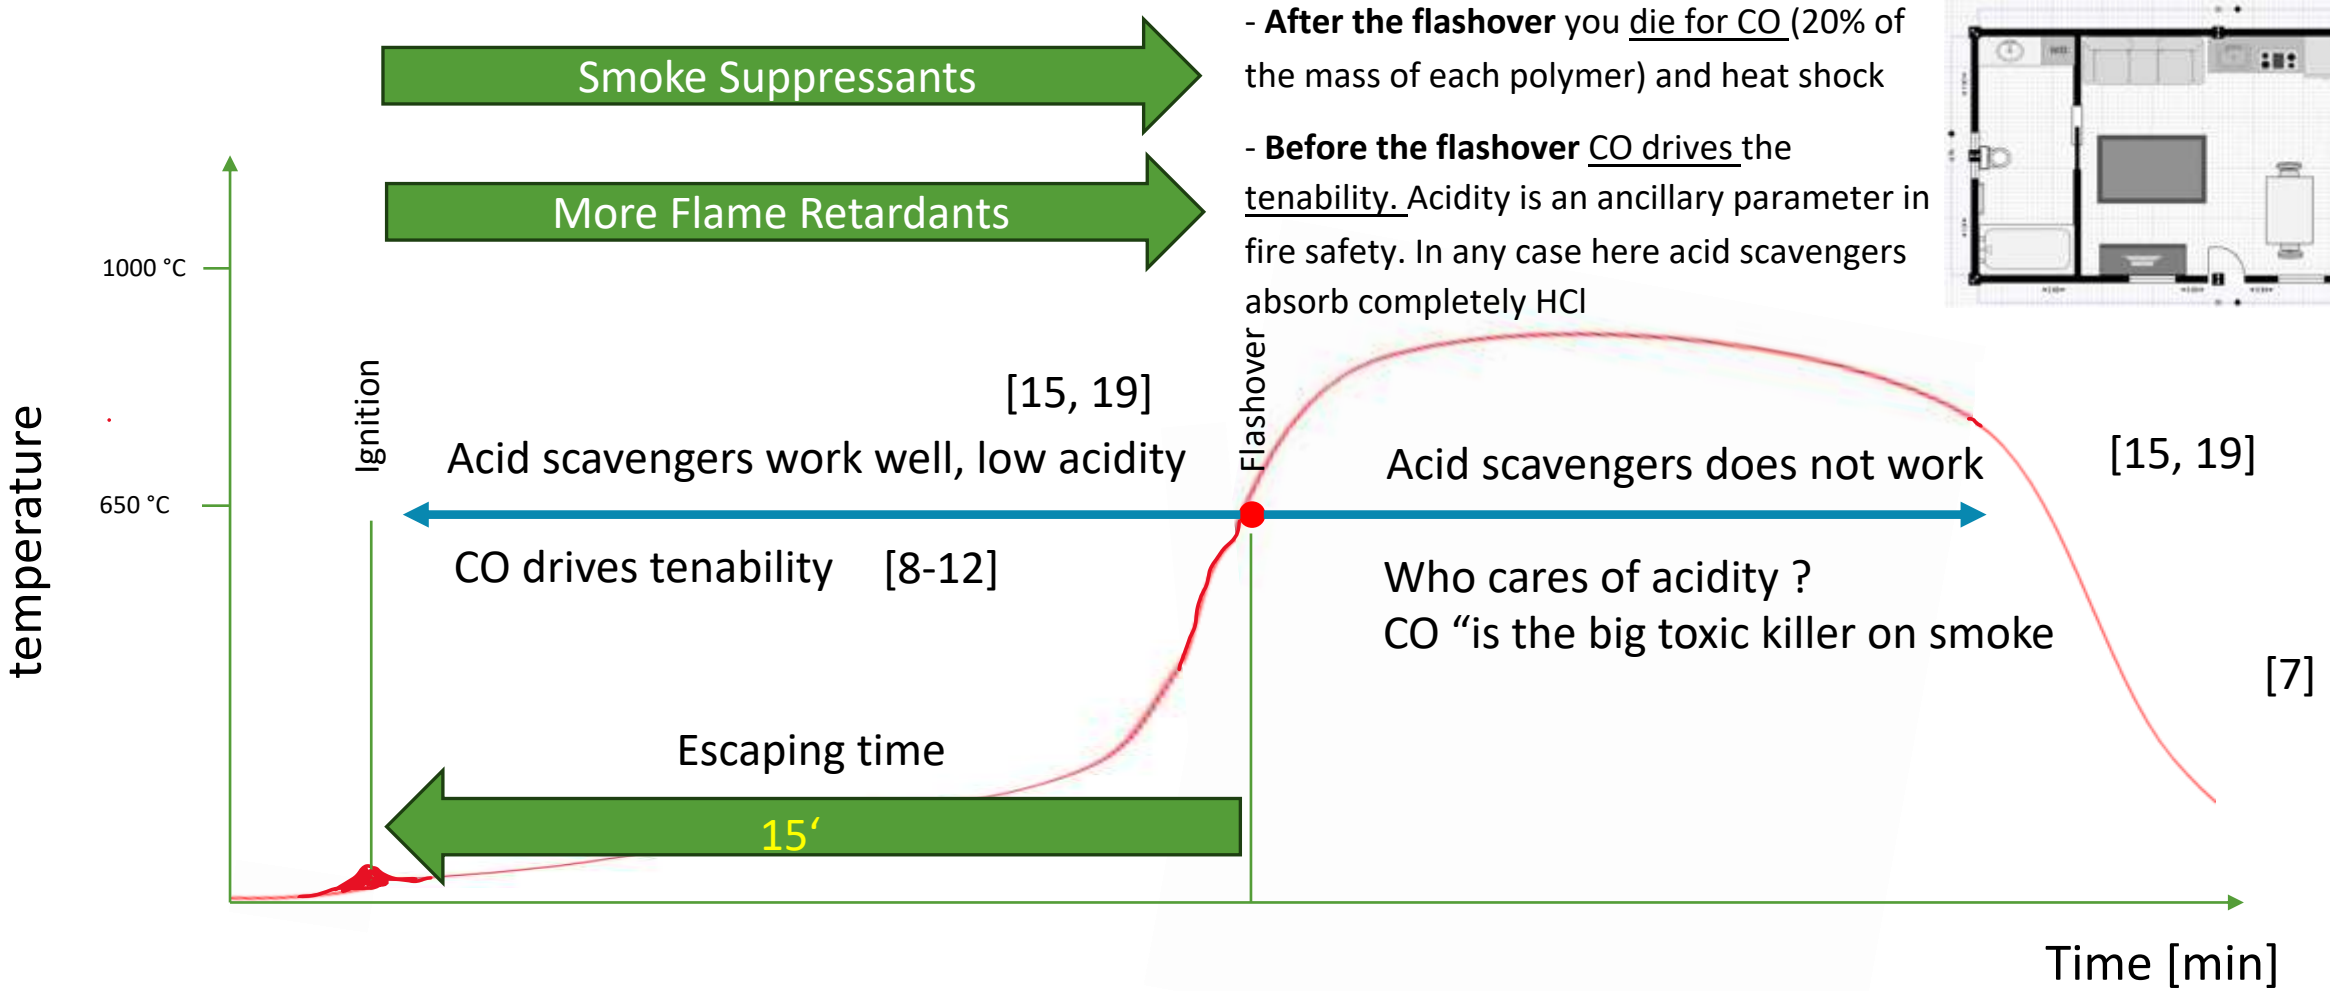

Ref. 33 gives the decomposition / combustion at 500 °C and 950°C of a standard R16 PVC compound, R16 LSA and the HFFR counterpart (M16), utilizing PY-GC/MS. Focus on total fuels


Volatile organic effluents released at 500°C

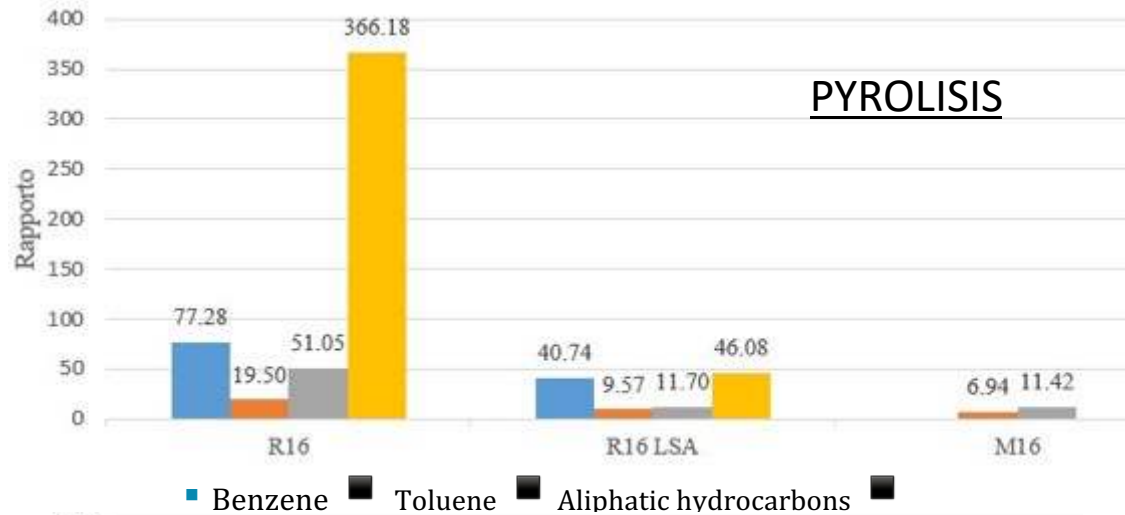

**COMBUSTION**



Volatile organic effluents released at 950°C

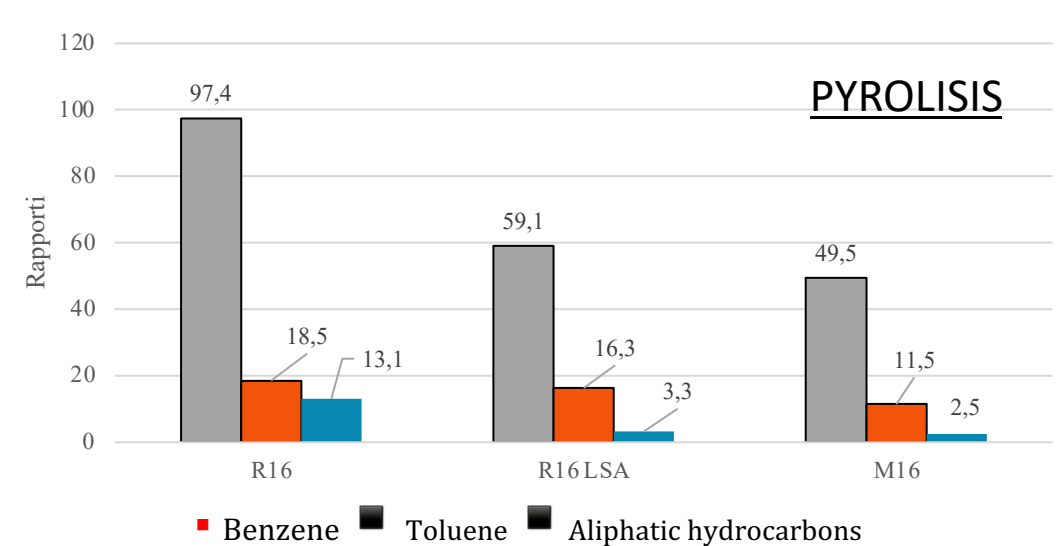


**COMBUSTION**

No signals, complete combustion


Ref. 33 gives the decomposition / combustion at 500 °C and 950°C of a standard R16 PVC compound, R16 LSA and the HFFR counterpart (M16), utilizing PY-GC/MS. Focus on fuels from polymers

Volatile organic effluents in R16 LSA/M16

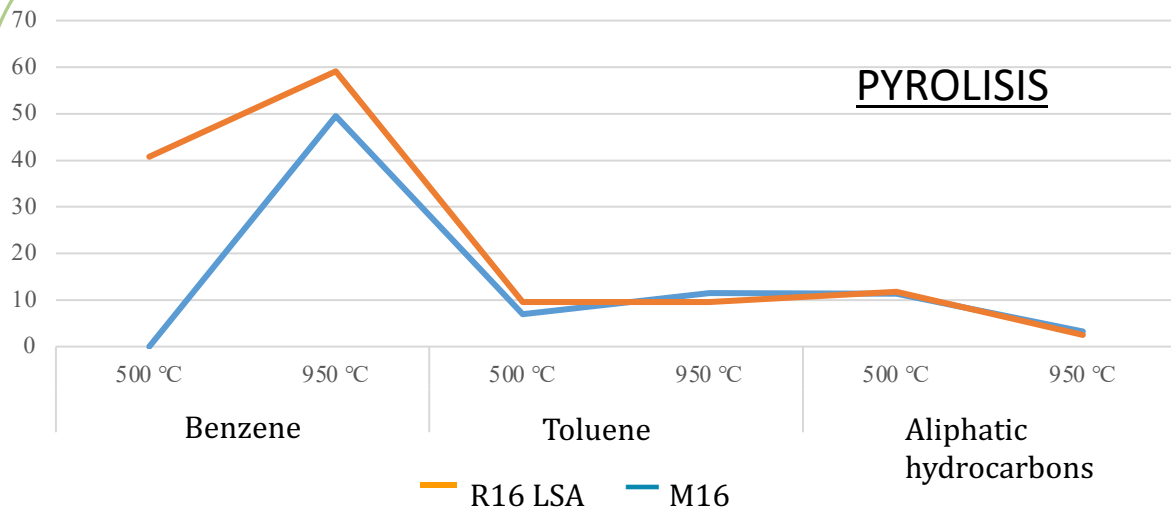

COMBUSTION

CO, CO<sub>2</sub> and H<sub>2</sub>O

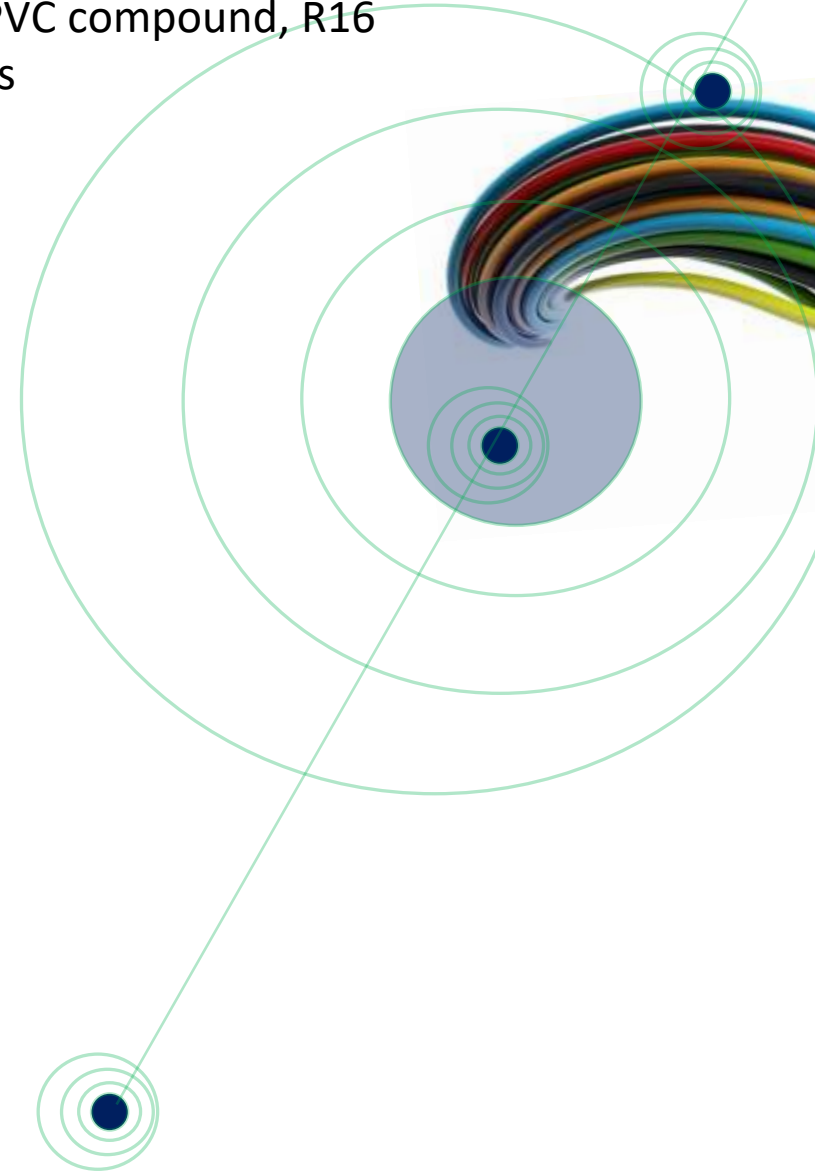

Ref. 33. evaluated each plastic component of the cables in Table 15.1 according to CEI 20-37/4-0. [27]  
It is a small-scale test where 1 g of compounds is totally burnt at 800 °C in a tube furnace with an air flow of 120 l/h for 20 min.

Toxicity Index T is calculated through the following formulation

$$T = C_1/C^{A_1} + C_2/C^{A_2} + \dots + C_i/C^{A_i} + C_n/C^{A_n}$$

Using as reference the toxic potentials of each component.


The method is a lab scale test burning completely the sample and not considering the amount of the material in the cables.

Cable	Diameter	Construction	Sheath Weight (g/m)	Insulation Weight (g/m, each)	Filler Weight (g/m)
Polythene-based cable FG16OM16 SG 1.5 mm <sup>2</sup> "zero halogen" (Lab ref: 900/24)	12.3 mm	1 sheath, 5 insulations, 1 filler	137.6	4.3	4.1
PVC-based cable FG16OR16 SG 1.5 mm <sup>2</sup> (Lab ref: 901/24)	12.1 mm	1 sheath, 5 insulations, 1 filler	145.8	4.4	4.3



Table 15.1

Component	C_CO2 (p.p.m.)	C_CO (p.p.m.)	C_HCl (p.p.m.)	Index T
"Zero halogen" cable Sheath	66364	2532	0	1.30
"Zero halogen" cable Insulation	50734	4453	0	1.62
"Zero halogen" cable Filler	96927	3755	0	1.91
PVC cable Sheath	85313	3580	469	2.69
PVC cable Insulation	50734	3754	0	1.45
PVC cable Filler	111946	5414	1340	5.15

Table 15.2



Ref. 33. evaluated also the classification of the 2 cables according to EN 50399 and using specific sensors for CO, CO<sub>2</sub> and HCl even the FED (fractional exposure dose) according to ISO 13344

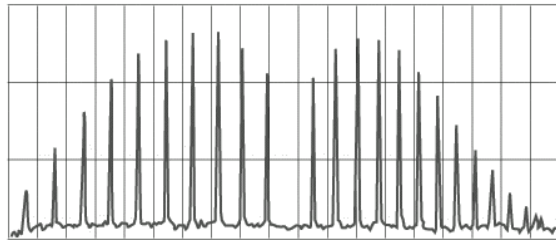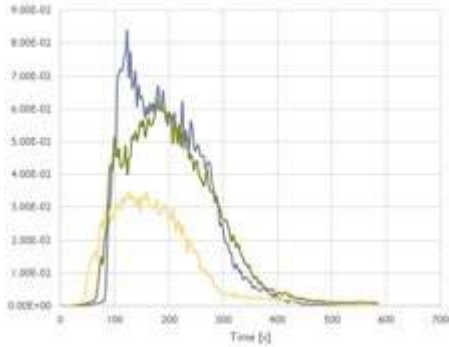


Smoke

SMOKE DETECTOR

CO, CO<sub>2</sub> and HCl

IR detector

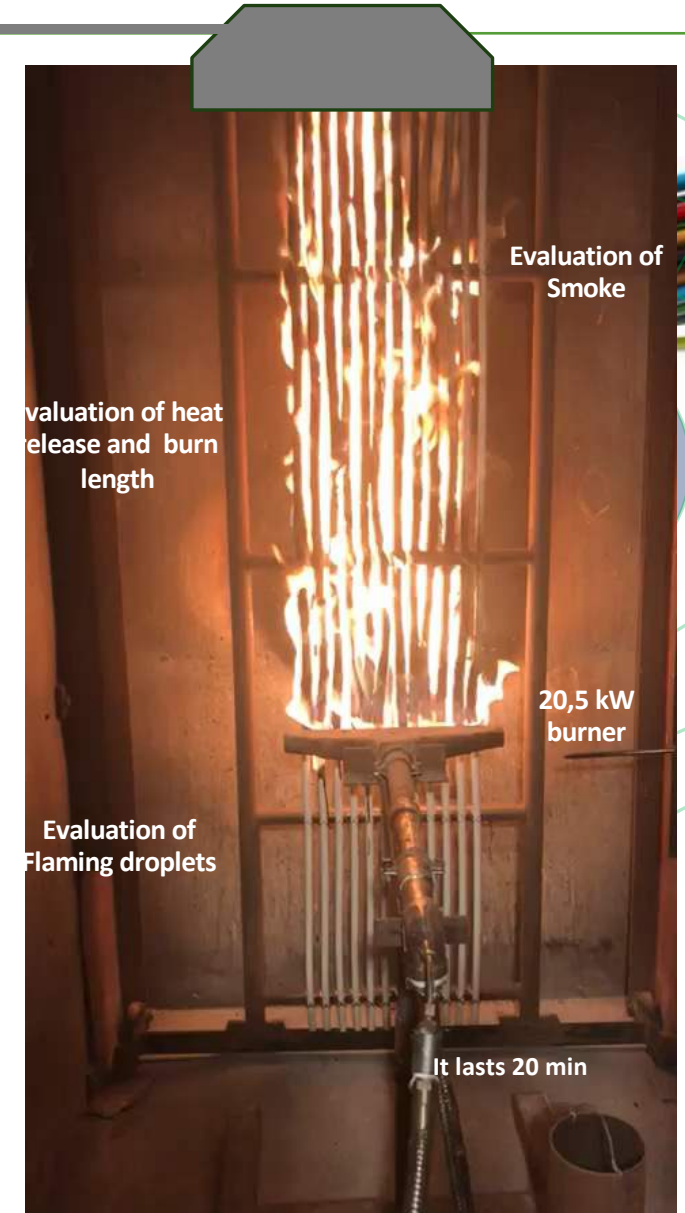

Picture 16: EN 50399 performed on FG16OR16 cable

Ref. 33. evaluated also the classification of the 2 cables according to EN 50399 and using specific sensors for CO, CO<sub>2</sub> and HCl even the FED (fractional exposure dose) according to according to ISO 13344

Table 17.1. shows the classification parameters. FG16RO16 LSA is much more performant than FG16OM16

Measurement	"Zero halogen" Polythene – based cable FG16OM16 5G 1,5 mm <sup>2</sup> (Laboratory reference no. 900/24)	PVC – based cable FG16OR16 5G 1,5 mm <sup>2</sup> (Laboratory reference no. 901/24)
Flame spread FS (m)	2.25	0.85
Total heat release THR <sub>1200s</sub> (MJ)	16.2	7.01
Peak of heat release rate Peak HRR (kW)	58	25
Fire growth rate index (max) Figra (W/s)	220	143
Peak of smoke release rate SPR (m <sup>2</sup> /s)	0.05	0.28
Total smoke released TSP 1200 s (m <sup>2</sup> )	15	82
Flaming droplets	None	None
Class according to EN 13501-6	<b>Dca, s1-d0</b>	<b>B2ca, s2-d0</b>


Table 17.1

Table 17.2. shows the FED. PVC cable ha a lower value due to the fact that it burns less.

	"Zero halogen" Polythene – based cable FG16OM16 5G 1,5 mm <sup>2</sup> (Laboratory reference no. 900/24)	PVC – based cable FG16OR16 5G 1,5 mm <sup>2</sup> (Laboratory reference no. 901/24)
CO <sub>2</sub>	3500 g	2890
CO	408 g	388
HCl	N/A	10 g
<b>FED</b>	<b>0.81</b>	<b>0.77</b>

Table 17.2

Ref 34, performing EN 50399, highlighted that the measure of CO production from low smoke acidity cable decays in time (yellow curve, Figure 18.1), while CO HFFR increases (green curve, Figure 18,1). CO particularly drops because it is linked to HCl concentration in the gas phase. (equation 1)



In absence of HCl this reaction can happen. When HCl decays CO decays. The cumulative production of CO LSA compounds is therefore much less comparing to standard PVC compound for cables even better than the best HFFR. (Figure 18,2 )

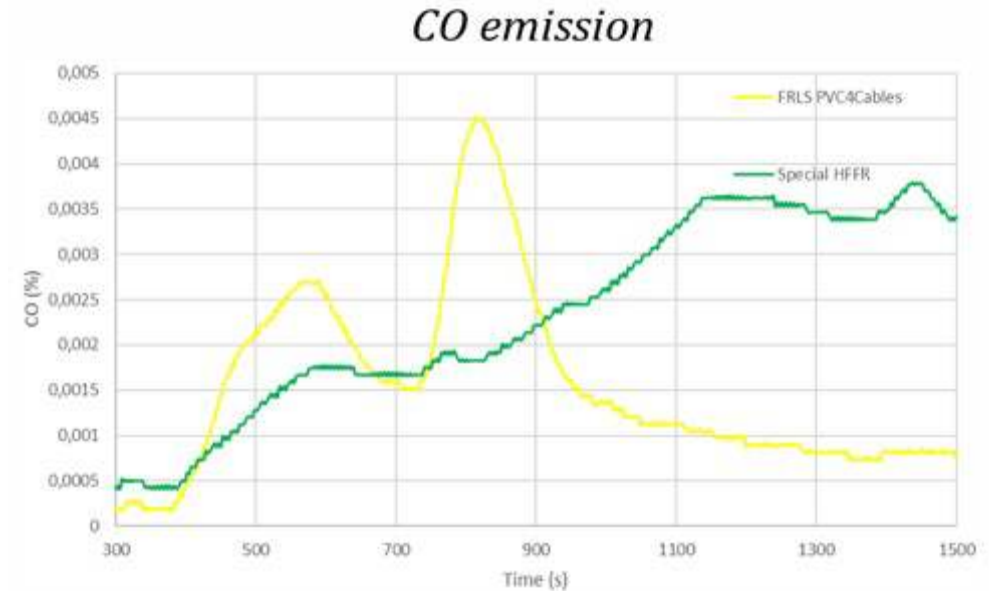
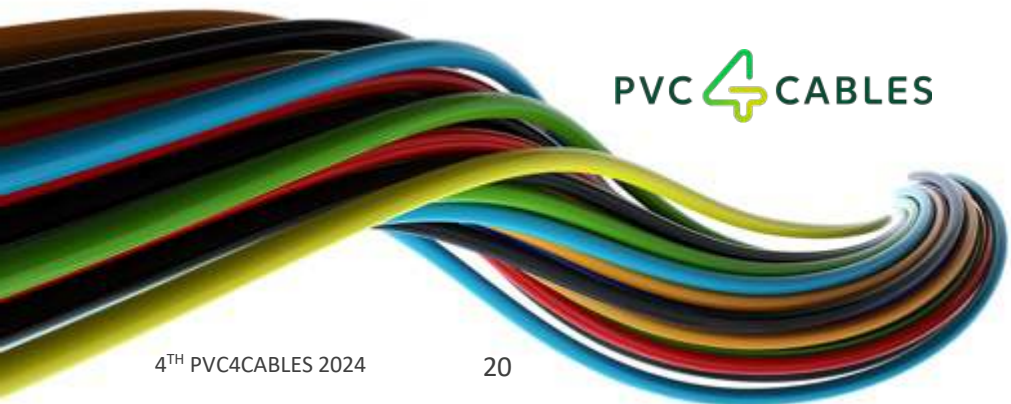


Figure 18,1

**FR(LS) PVC vs HFFR compounds: total CO Production evolution**

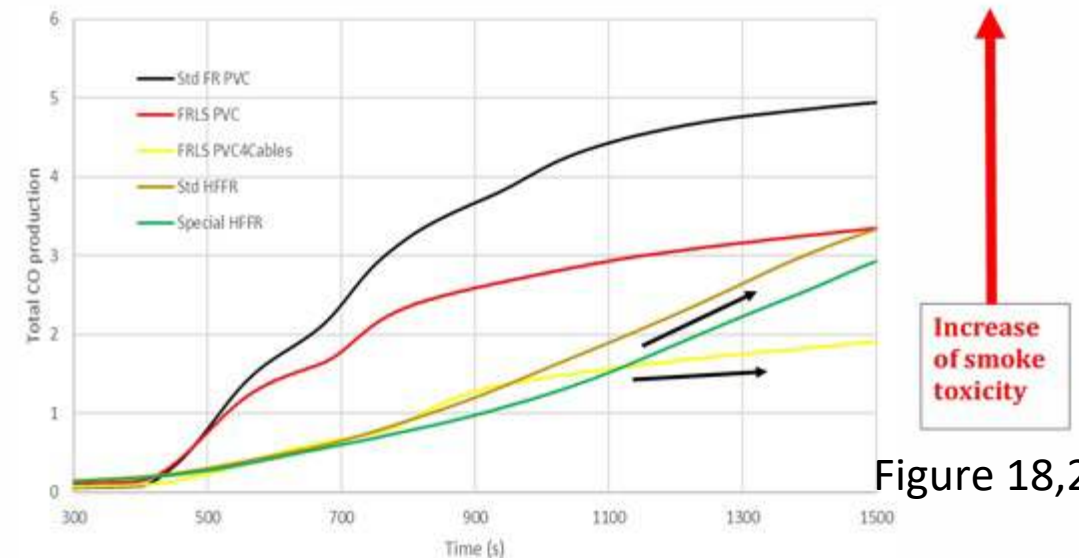


Figure 18,2

# 4

# New LSA Cables: real fire scenario n. 1

**Fire Scenario number 1:** A room goes in flashover, people die for:


CO monoxide

Hot air (> 80 °C)


Heat

Collapse of the structure

**FR(LS) PVC vs HFFR compounds: total CO Production evolution**

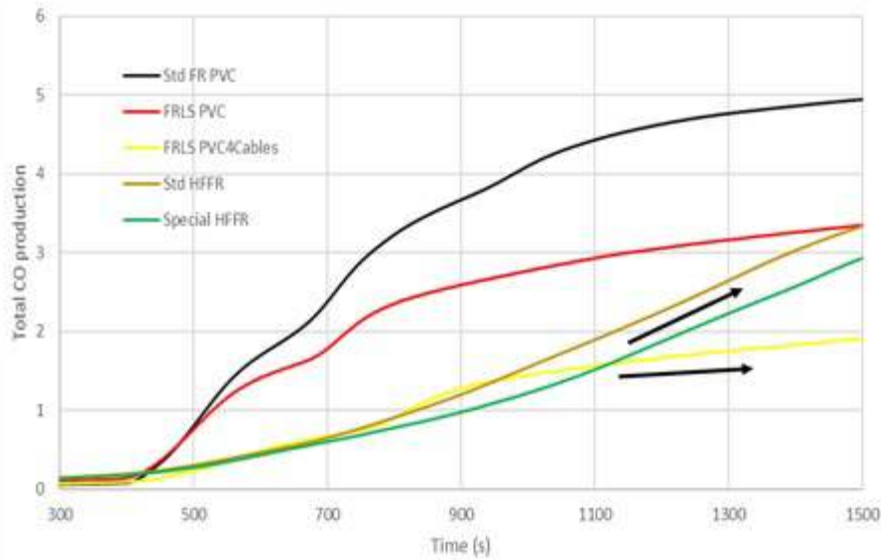


Increase of smoke toxicity

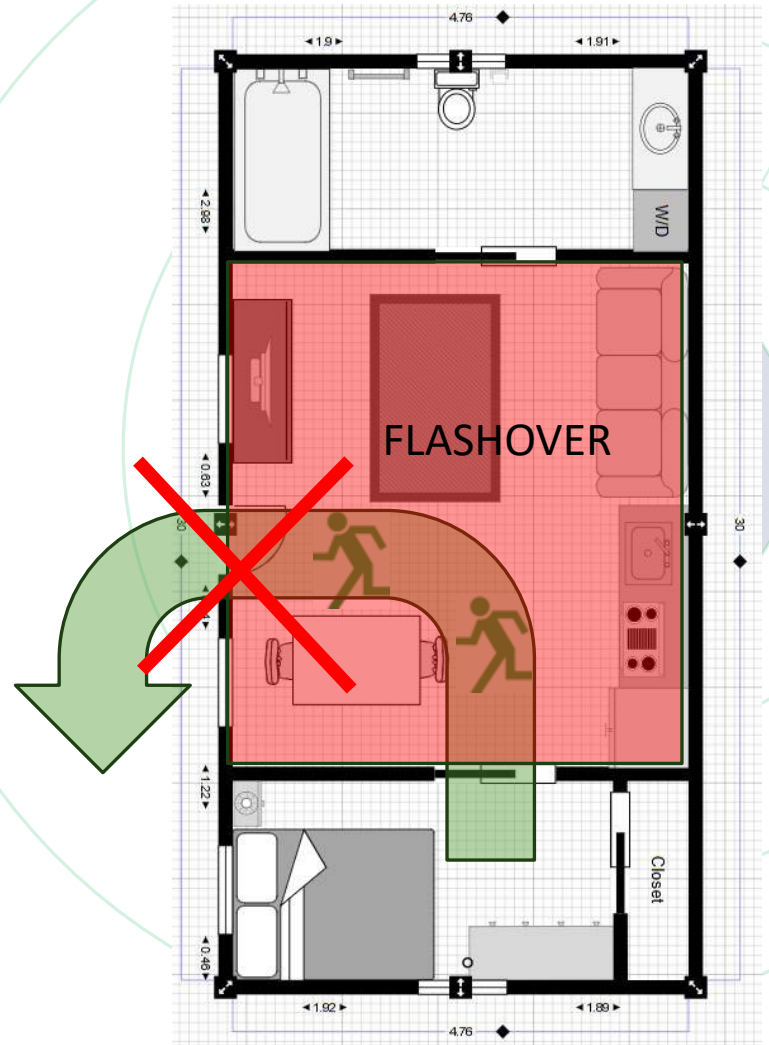


**Fire Scenario number 4 and 5:** A room goes in flashover, and people die for: CO monoxide is the dominant intoxicant, HCl decays and it is release later because PVC article burn later than the common furnishing in the location.

**FR(LS) PVC vs HFFR compounds: total CO Production evolution**

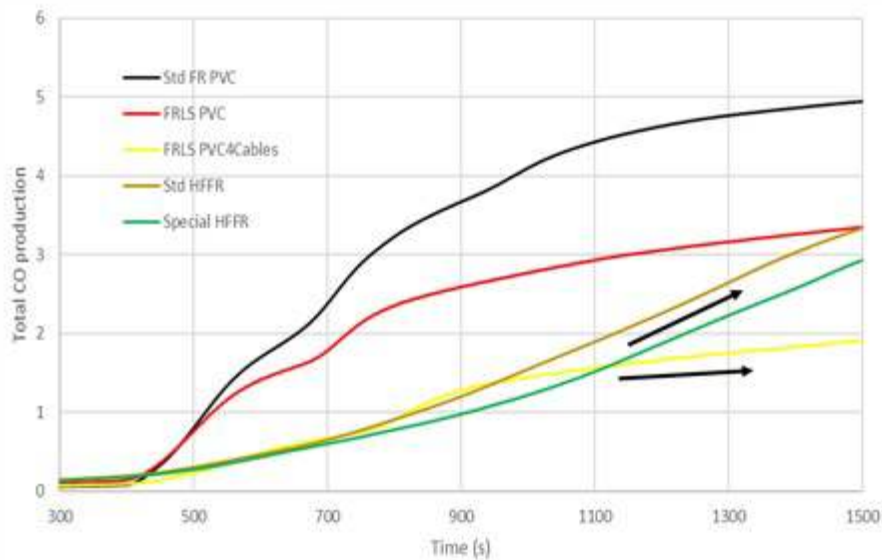



Increase  
of smoke  
toxicity

CO drives  
tenability limits

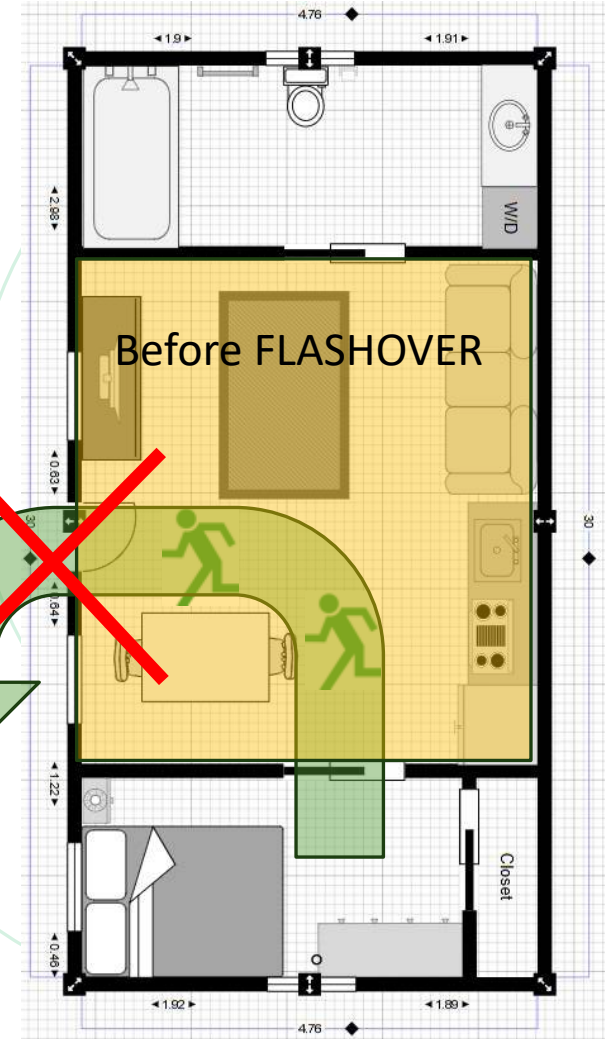

**Fire Scenario number 6:** A room goes in flashover, HCl is released (Acid scavengers do not work), HCl decays, CO from PVC is less than HFFR and does not travel far from the location where it originated. CO is released in the same amount after the flashover from every polymer (20% of their mass)

*CO emission*

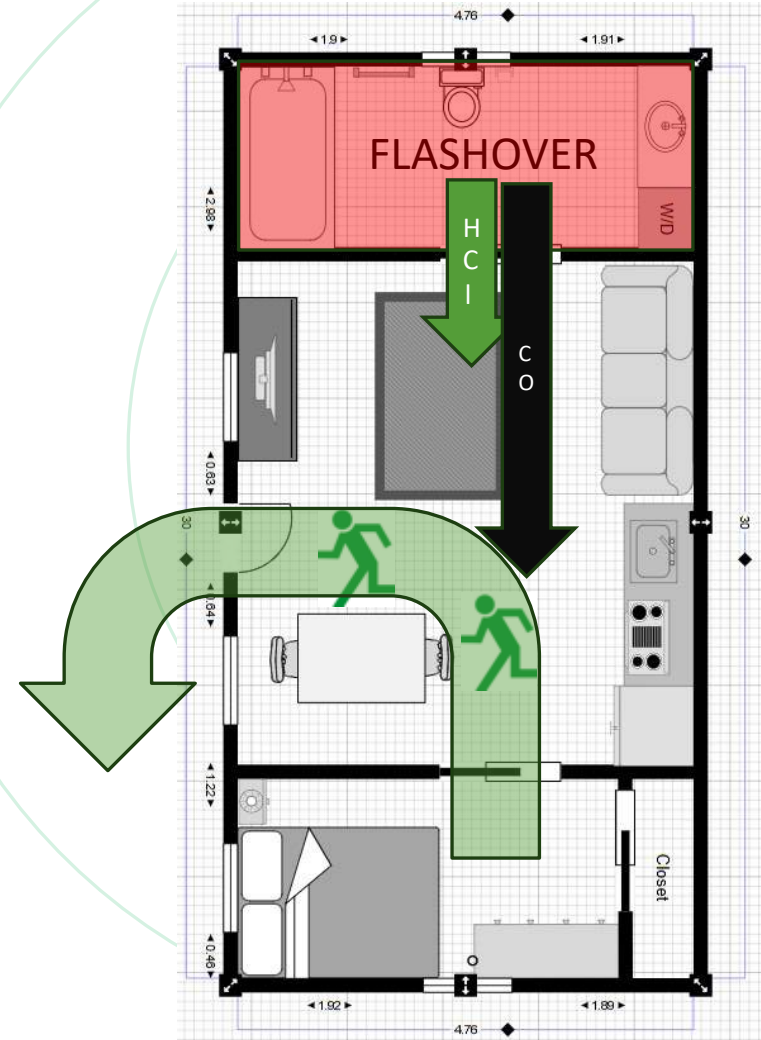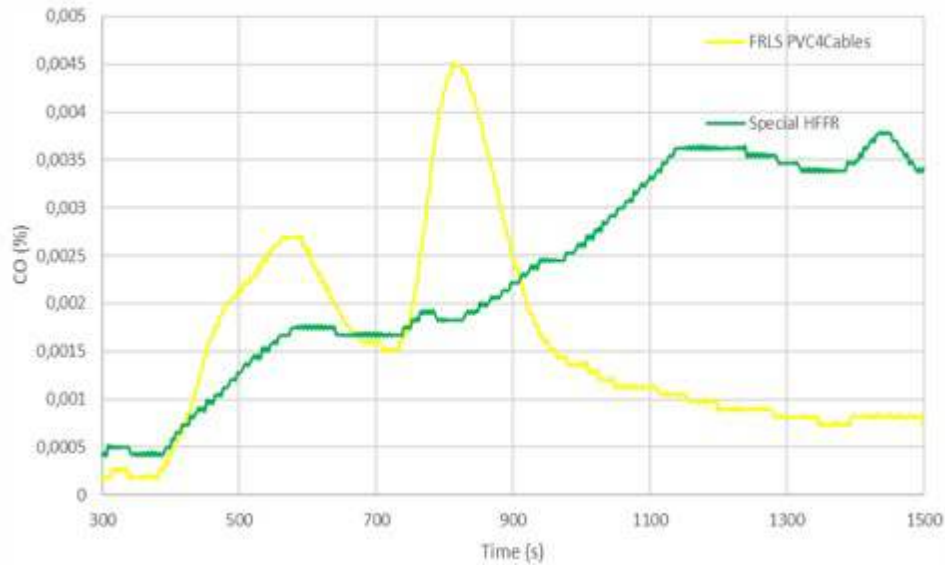

- 1) Toxicity of the effluents is mainly related to CO, and acidity assessment has no correlation with toxicity
- 2) Small scale tests that evaluating toxicity are not representative of real fire scenarios
- 3) The use of EN 50399 with sensors for CO, CO<sub>2</sub> and HCl confirmed that it can be a powerful method for assessing the effluent toxicity in combination with ISO 13344 through FED
- 4) LSA cables showed higher toxicity potential in small scale and lower in medium scale (FED 0,77 vs. 0,81)
- 5) The EN 50399 + sensors must be repeated for the third time to confirm definitely the data
- 6) In real fire scenarios HCl decays and the HCl quantity in the gas phase could be even less
- 7) Large scale tests are suggested for assessing if HCl is a real concern in the fire safety

- [1] CEI EN 50620/A1: Electric Vehicle Charging Cables; Comitato Elettrotecnico Italiano (CEI). Milan, 2021. Available online: <https://mycatalogo.ceinorme.it/cei/item/0010017897> (accessed Oct 9, 2024).
- [2] CEI EN 50618: Cavi elettrici per impianti fotovoltaici; Comitato Elettrotecnico Italiano (CEI). Milan, Italy, 2015. Available online: <https://mycatalogo.ceinorme.it/cei/item/0000014504?sso=y> (accessed Oct 9, 2024).
- [3] Piana, M.; Sarti, G. A Focus on PVC Cables: Innovation and Fakes. *4th Annual PVC Compounding & Production Cycle Forum*, Rome, January 2023. DOI: 10.13140/RG.2.2.19534.54087. Available online: [https://www.researchgate.net/publication/367328130\\_A\\_focus\\_on\\_PVC\\_Cables\\_innovation\\_and\\_fakes](https://www.researchgate.net/publication/367328130_A_focus_on_PVC_Cables_innovation_and_fakes) (accessed October 9, 2024).
- [4] European Parliament and Council. *Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations, and administrative provisions of the Member States relating to construction products*; Official Journal of the European Communities: Brussels, Belgium, 1989. Available online: <https://eur-lex.europa.eu/legal-content/EN/TXT/PDF/?uri=CELEX:31989L0106> (accessed October 9, 2024).
- [5] European Parliament and Council. *Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011 laying down harmonized conditions for the marketing of construction products and repealing Council Directive 89/106/EEC*; Official Journal of the European Union: Brussels, Belgium, 2011. Available online: <https://eur-lex.europa.eu/legal-content/EN/TXT/PDF/?uri=CELEX:02011R0305-20210716> (accessed October 9, 2024).
- [6] Babrauskas, V.; Peacock, R. D. Heat Release Rate: The Single Most Important Variable in Fire Hazard. *Fire Saf. J.* 1992, 18(3), 255–272. DOI: 10.1016/0379-7112(92)90019-9.
- [7] Hirschler, M. M. Fire Safety, Smoke Toxicity and Acidity. In *Proc. Flame Retardants 2004*; Interscience Communications: London, UK, 2006; pp 47–58. Available online: <https://citeseerx.ist.psu.edu/document?repid=rep1&type=pdf&doi=8a3c0b2110638d8bb351105ca451efaf22f10031> (accessed October 9, 2024).
- [8] Debanne, S. M.; Hirschler, M. M.; Nelson, G. L. The Importance of Carbon Monoxide in the Toxicity of Fire Atmospheres. In *Fire Hazard and Fire Risk Assessment*, ASTM STP 1150; Hirschler, M. M., Ed.; American Society for Testing and Materials: Philadelphia, PA, 1992; pp 9–23.
- [9] Hirschler, M. M. (Editor-in-Chief); Debanne, S. M.; Larsen, J. B.; Nelson, G. L. *Carbon Monoxide and Human Lethality - Fire and Non-Fire Studies*; Elsevier: London, UK, 1993.
- [10] Hirschler, M. M. Fire Retardance, Smoke Toxicity and Fire Hazard. In *Proc. Flame Retardants '94*; British Plastics Federation; Interscience Communications: London, UK, January 26-27, 1994; pp 225–237.
- [11] International Organization for Standardization. *ISO/TR 20118:2019 - Plastics — Guidance on fire characteristics and fire performance of PVC materials used in building applications*; ISO: Geneva, Switzerland, 2019. Available online: <https://www.iso.org/standard/67071.html> (accessed October 9, 2024).
- [12] Guillaume, E.; Didieux, F.; Thiry, A.; Bellivier, A. Real-scale Fire Tests of One Bedroom Apartments with Regard to Tenability Assessment. *Fire Saf. J.* 2014, 70(2), 50–57. DOI: 10.1016/j.firesaf.2014.08.014.
- [13] Sarti, G.; Piana, M. PVC in Cables for Building and Construction. Can the “European Approach” Be Considered a Good Example for Other Countries? *Academia Letters* 2022. DOI: [10.20935/AL5453](https://doi.org/10.20935/AL5453).
- [14] Sarti, G. A New Perspective on Hydrogen Chloride Scavenging at High Temperatures for Reducing the Smoke Acidity of PVC Cables in Fires: An Overview of the Theory, Test Methods, and the European Union Regulatory Status. *Fire* 2022, 5, 127. DOI: 10.3390/fire5050127.
- [15] Sarti, G. A New Perspective on Hydrogen Chloride Scavenging at High Temperatures for Reducing the Smoke Acidity of PVC Cables in Fires. II: Some Examples of Acid Scavengers at High Temperatures in the Condensed Phase. *Fire* 2022, 5, 142. DOI: 10.3390/fire5020142.
- [16] Bassi, I.; Bandinelli, C.; Delchiaro, F.; Sarti, G. A New Perspective on Hydrogen Chloride Scavenging at High Temperatures for Reducing the Smoke Acidity of PVC in Fires. III: EN 60754–2 and the Species in Solution Affecting pH and Conductivity. *Preprints* 2024, 2024021727. DOI: 10.20944/preprints202402.1727.v1.
- [17] Bassi, I.; Delchiaro, F.; Bandinelli, C.; Mazzocchetti, L.; Salatelli, E.; Sarti, G. A New Perspective on Hydrogen Chloride Scavenging at High Temperatures for Reducing the Smoke Acidity of PVC Cables in Fires, IV: The Impact of Acid Scavengers at High Temperatures on Flame Retardance and Smoke Emission. *Fire* 2023, 6, 259. DOI: 10.3390/fire6070259.
- [18] Bassi, I.; Bandinelli, C.; Delchiaro, F.; Piana, M.; Sarti, G. A New Perspective on Hydrogen Chloride Scavenging at High Temperatures for Reducing the Smoke Acidity of PVC Cables in Fires V: Comparison between EN 60754-1 and EN 60754-2. *Fire* 2023, 6, 326. DOI: 10.3390/fire6080326.
- [19] Sarti, G.; Piana, M. New Formulations and Test Comparison for the Classification of PVC Cables under EU Regulation n° 305/2011 for Construction Products. In *AMI Cables 2019*; Düsseldorf, Germany, March 2019;.
- [20] Sarti, G.; Piana, M. PVC Cables and Smoke Acidity: A Review Comparing Performances of Old and New Compounds; Presented at AMI Cables 2020, Düsseldorf, Germany, March 2020.
- [21] Piana, M.; Sarti, G. Smoke Acidity and a New Generation of PVC Formulations for Cables. In *AMI Formulation 2021*; Cologne, Germany, November 2021.
- [22] Delchiaro, F.; Bandinelli, C.; Bassi, I.; Sarti, G. Developing and Improving Fire Performance and Safety in PVC; Presented at the Future of PVC Compounding, Production & Recycling Conference, Feb 24-25, 2022.

- [24] Sarti, G.; Bandinelli, C.; Bassi, I.; Piana, M. Acidity Additional Classification in Cables and Its Impact on PVC Cables Compounds Growth; Presented at the Future of PVC Production, Compounding & Recycling Conference, Brussels, March 2023.
- [25] Delchiaro, F.; Bandinelli, C.; Bassi, I.; Sarti, G. New Sustainable Flame Retardants and Smoke Suppressants in Unplasticized PVC Compounds; Presented at the 3rd Future of PVC Compounding Production and Recycling Forum, Brussels, Belgium, March 2024.
- [26] Delchiaro, F.; Bandinelli, C.; Bassi, I.; Sarti, G. New Generation PVC Compounds for Cables and Safety in Case of Fire; Presented at PVC 2024, Edinburgh, April 2024.
- [27] Comitato Elettrotecnico Italiano. *CEI 20-37/4-0: 2020 - Metodi di prova comuni per cavi in condizioni di incendio - Prove sui gas emessi durante la combustione dei materiali prelevati dai cavi. Parte 4: Determinazione dell'indice di tossicità dei gas emessi.* CEI, Milano, Italy, 2020. Accessed October 9, 2024.
- [28] EN 50399:2024, *Common test methods for cables under fire conditions - Heat release and smoke production measurement on cables during flame spread test - Test apparatus, procedures, results*; European Committee for Standardization: **CEN**. Brussels, Belgium, 2024. Accessed October 9, 2024.
- [29] ISO 13344:2015, *Estimation of the lethal toxic potency of fire effluents*; International Organization for Standardization: **ISO**. Geneva, Switzerland, 2015. Accessed October 9, 2024.
- [30] Lombardi, P. Comportamento al fuoco di compounds in PVC standard e a bassa emissione di fumi acidi vs compounds halogen free per cavi elettrici, II: Focus su effluenti organici sviluppati; Master's Thesis, University of Bologna, Dipartimento di Chimica Industriale "Toso Montanari," Bologna, Italy, 2023.
- [31] ASTM International. **ASTM D7309-21B**: Standard Test Method for Determining Flammability Characteristics of Plastics and Other Solid Materials Using Microscale Combustion Calorimetry; ASTM International: West Conshohocken, PA, 2021.
- [32] Wang, Y.; Cheng, L.; Gu, J.; Zhang, Y.; Wu, J.; Yuan, H.; Che, Y. Catalytic Pyrolysis of Polyethylene for the Selective Production of Monocyclic Aromatics over the Zinc-Loaded ZSM-5 Catalyst. *ACS Sustainable Chem. Eng.* **2022**, *10* (6), 5895–5905. <https://doi.org/10.1021/acssuschemeng.2c01234> (accessed Oct 10, 2024).
- [33] LAPI S.p.A. The Evaluation of the Potential Hazard Posed by the Fire Effluents from the Combustion of Electrical Cables: A Survey of the Current Methods of Evaluation and a Proposal for a Possible Alternative Approach: Test Data and Discussion (Rev. 2); Internal Report, LAPI S.p.A., Italy, 2024.
- [34] Cardelli, C. CPR Classification of Cables and Fire Safety: Contribution of Innovative PVC and Halogen-Free Compounds. Presented at AMI Cable 2022, March 2022.

(PDF) Full paper is available here)



PVC Forum Italia ([www.pvcforum.it](http://www.pvcforum.it)) is the Italian association that brings together the leading companies in the production, compounding, and processing of PVC, as well as manufacturers of additives and processing machinery. Based in Milan, PVC Forum is part of the European network of PVC forums connected to ECVN (European Council of Vinyl Manufacturers), the European association of PVC producers, which is a division of the association of European plastics producers (PlasticsEurope).

**[www.pvcforum.it](http://www.pvcforum.it)**



VinylPlus® is the Voluntary Commitment to the sustainable development of the European PVC industry. The program was developed through an open dialogue with stakeholders, involving industry, NGOs, legislators, representatives of civil society, and end-users of PVC. VinylPlus® operates in the 27 European Union countries plus Norway, Switzerland, and the UK. VinylPlus® is registered as a SMART partnership on the UN's Partnerships for the SDGs platform.

**[vinylplus.eu](http://vinylplus.eu)**



PVC4Cables is the ECVN platform dedicated to the PVC cable supply chain. It brings together PVC resin producers, stabilizer and plasticizer manufacturers, and PVC compounders. It is open to the participation of PVC cable manufacturers, recyclers, and industry associations. PVC4Cables aims to be a driver for environmentally compatible innovations in the PVC cable sector and to serve as a point of reference for dialogue and communication with all stakeholders: cable manufacturers, legislators, designers, installers, electricians, media, and the general public.

**[www.pvc4cables.org](http://www.pvc4cables.org)**



Thank you for your  
attention



vinyl<sup>plus</sup>

Via Giovanni da Procida, 11 - 20149 Milano  
Tel. 02 33604020  
[www.pvcforum.it](http://www.pvcforum.it) e-mail: [info@pvcforum.it](mailto:info@pvcforum.it)

PVC  CABLES